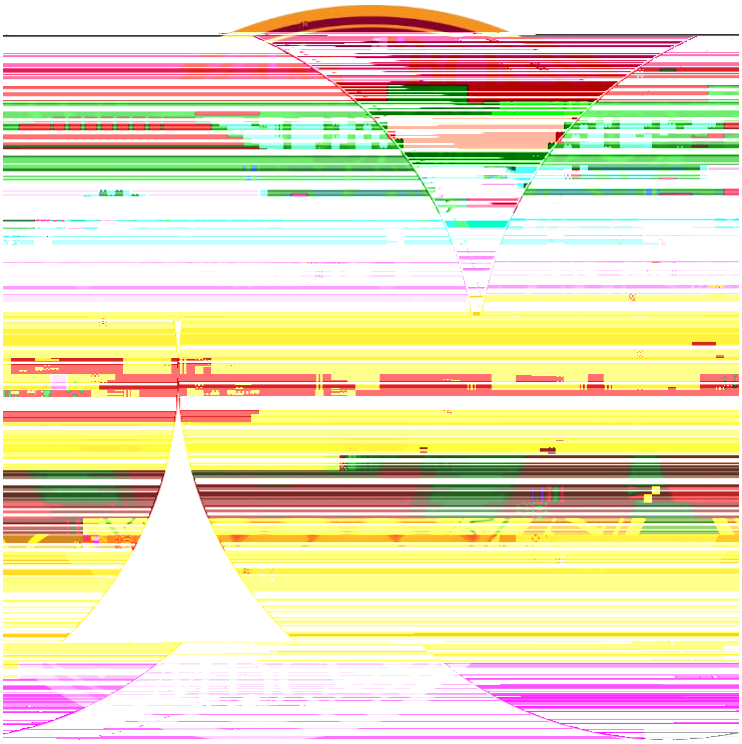

The Energy Impacts of Self Generating Electrical Cardiovascular Equipment on the Quonset Hut at Boston College

Benjamin Ruffing, Erin Walsh, and Zachary Contini

ENVS4943.01 Senior Environmental Seminar

Professor Tara Pisani Gareau

April 29, 2021

Abstract

I. Introduction

cardio equipment in the Hut which need to be plugged in and the rest of the equipment is self-generating. Given its location and age, the Hut typically gets much less usage than the Margot Connell Recreation Center at the school's main campus, but it is still a well-utilized asset on Newton's campus. Currently, the Hut has recently replaced approximately half of the fluorescent tube lighting it has been using with more efficient LED lighting, however, this tube lighting still remains in a portion of the Hut. This lighting is also controlled of ed7(h)-2rll

D.

the data collection methods for equipment energy usage. These will be based on historical collections and current set-ups.

than the 2019-2020 academic year since campus was closed in March so students were not on campus for a traditional year. Therefore, the 230 operational days in a year is an accurate value.

The assumptions that follow should not be taken as confidently accurate. Therefore, it is essential to consider multiple scenario analyses because there is no best accurate way to measure some of these variables. Based on various informal questions asked to students and casual observations of student behavior, it is determined that the average student exercises for 1 hour during the day. This does not include time it takes to change and transportation but does include time between sets of strength work and stretching. Some students will use the Hut strictly for cardio exercise, some will use the Hut strictly for strength work and others will be a combination of the two forms of exercise. An assumption made is that 50% of a student workout will be on a cardiovascular machine. Therefore, since the average length of a student workout is 1 hour, then the average amount of time spent doing cardio exercise is 0.5 hours or 30 minutes. Since there are 7.67 students on average in the hut at a particular time, then there are 3.84 students exercising on a cardiovascular machine at any particular time. It should be reiterated that this is an average calculation and not representative of every point throughout the day. This value would fluctuate throughout the day.

There were 4 treadmills, 4 indoor cycles and 2 ellipticals in the Quonset Hut in February 2020. This set-up of the Hut is very tight with minimal additional space for more equipment. If more cardio equipment were to be added, it would likely require some removal of some strength equipment. This means there are essentially a maximum of 10 potential spaces for cardio equipment. The utilization factor for the cardio equipment is percent of time the cardio machines are in use during the day. Assuming that students have an equal likelihood to use either the treadmill, indoor cycle or the elliptical then the utilization factor is determined to be 38%. The utilization factor is important to consider when determining whether there will be an available

Therefore, sinc a studen he HutQq0.G[T)7ent doing cardio exercis This means there This means thereude sihe Huy2 reV

faster pace over a time period. This value averages out the differences between males and females.

The energy estimates for each of these three machines have now been assumed. They can be equally averaged to yield an average amount of energy generated for all cardio machines. This assumes that these three machines have equal demand and there is no preference of a certain cardio machine. The average cardio equipment energy generation can then be determined for both a weekly and operational yearly amount. The number of machines is not a direct factor into this calculation since it has already been analyzed using the utilization factor which is well under 100%. The total amount of energy generated in a week based on these standard assumptions is 50,885 Wh or 50.885 kWh. The total amount of energy generated in an operational year based on these standard assumptions is 1,671,947 Wh or 1,671.947 kWh. This is the amount of energy that could be put back into the energy grid to offset the uses from other energy producing parts of the Hut. These energy assumptions are all outlined and summarized in the table in Exhibit 4.

The energy generation for the Hut has now been determined based on standard assumptions. Now there will be a discussion of the cost-benefit analysis of installing these cardio machines. SportsArt does not disclose their prices publicly. Therefore, the sales representatives were contacted in order to obtain pricing for their Eco-Powr line products. It is important to note that all machines were offered at their standard university discount rate of 40% off the list price. The prices for these products after the discount for the G690 Eco-Powr treadmill is $6,414, the G510 Eco-Powr indoor cycle is $1,797 and the G876 Elliptical is $5,277. In order to determine the cost-

greater than the Eco-Powr line respective products. Yet, it can most likely be assumed that these prices could be negotiated down to the same 40% university discount prices. Therefore, the discounted prices for machines are $5,669 for the platinum club series treadmill, $1,439 for the IC6 indoor cycle and $5,039 for the platinum club elliptical. These price differences are shown in the table in Exhibit 5. The total price difference can then be determined based on how many new machines the Quonset Hut would purchase based on their current machine capacity of 10 total machines with 4 treadmills, 4 indoor cycles and 2 ellipticals.

In order to determine the cost-benefit analysis, the financing for these machines must be accurately calculated. The Eco-Powr machines could either be paid entirely up-front or leased through monthly installments. In the leasing option the purchaser pays an upfront cost which is essentially a down deposit and then the monthly payments begin. It is assumed that BC would pursue the leasing option since the overall cost would be lower because the payments are over a period of time. In order to accurately compare the Eco-Powr machines and the Life Fitness machines the assumption must be made that they can be financed in the same manner over the same period of time and with the same up-front cost percentage. This is likely to deviate slightly in practice since it would be unlikely that the terms of the lease would be exact across both options. Nonetheless, it would still not be significantly different and could probably be negotiated in BC's favor. The Eco-Powr equipment is warranted on parts for 5 years and 3 years on labor. Yet, the useful life of the equipment could be doubled to 10 years if it is well maintained. Considering that the equipment will be used heavily and is being leased for a public gym, it is assumed that the 5 year warranty accurately represents the useful life of the equipment. Yet, this can be changed in scenario analysis. For the financing calculation, the assumption is made that 20% of the total cost will be paid before the monthly payments begin. Additionally, it is assumed that the discount rate on the monthly installments is 10%. This is based on historical market returns over the S&P 500 in recent decades and is a traditionally used discount rate for financing projects. Therefore, the price difference and discounted price difference taking into consideration the 10% rate can be calculated each month over 5 years.

replace older models over the course of a given time period either way, which raises the importance of considering the relative cost of an energy-producing cardio machine as opposed to the standard cardio machine. Two potential scenarios would benefit the school financially: the machines are able to pay back the difference in price between the standard machine or the machines are able to pay themselves back in full. In either scenario, the school saves money on its purchase. In order to determine whether these criteria can be met in a reasonable time for the school, a multi-phased cost-analysis must be conducted. This process will be conducted through four steps: utilizing energy production from these machines to determine the amount of energy produced in a typical time frame, determining the cost of electricity for the Boston area, calculating the savings per year which result from the energy production, using these savings estimates to calculate the time needed to achieve both of these conditions. This determination will shed light on another cost consideration angle for the school to consider.

III. Results

The levelized cost of energy (LCOE) is an important value to determine the cost-benefit analysis for the project. The LCOE compares the costs of an energy source over its energy output to determine which is the most cost efficient for energy generation. It is essentially an equation of costs over energy output. A lower LCOE is better because less cost goes into energy production. When calculating the LCOE for the Eco-Powr project there are assumptions that must be made. First, since the Life Fitness machines do not generate any electricity themselves, the only energy generation is derived from the Eco-Powr equipment. Therefore, the energy generation can be taken from the previously calculated total energy generation over the academic year and equally distributed across the 12 months during the year. This is not the most accurate way to allocate the energy usage since the Quonset Hut is not open during the summer months and various months may have more cardio equipment usage than others, but it is a close enough approximation for the purposes of this analysis. The monthly discounted price can then be used as the cost for the energy in the LCOE calculation. The LCOE is then determined for each month which can then be calculated for each of the 5 years. The first year has the highest LCOE because of the 20% down payment prior to the start of the monthly payments. Each year subsequently has a lower LCOE due to the impacts from the discount factor over longer time horizons. The energy output remains constant, but the cost for the energy decreases each

month. The total project LCOE can be calculated from averaging the 5 years together to yield an LCOE of $0.468/kWh. The LCOE values over the 5 years are shown in the table in Exhibit 6.

These LCOE values now need to be compared to the LCOE of other energy sources. Lazard publishes yearly unsubsidized LCOE values for renewable and conventional sources of energy. These values are summarized in the graphic in Exhibit 7. In general, the LCOE for renewables has been declining as the price for solar panels has generally been decreasing. Many of these technologies are now at a financially comparable level to other conventional sources of energy. This is a promising step forward for the future of renewable energy since the LCOE takes into consideration all costs of the project including the higher up-front cost from renewable energy. Therefore, it is more difficult to argue from a financial perspective that renewables could become a greater energy source for the future when these LCOE costs are dropping rapidly. Lazard gives the LCOE values in units of $/MWh so each price must be divided by 1,000 to compare with the Eco-Powr LCOE in $/kWh. When comparing the Eco-Powr LCOE with the renewable and conventional energy sources LCOE it is apparent that Eco-Powr energy source is significantly more expensive than any of the other sources. For example, assuming BC receives the majority of its energy from natural gas under the gas combined cycle from Lazard analysis. Even using the lower LCOE of $0.044/kWh is a magnitude of over 10 times cheaper than the $0.468/kWh from the Eco-Powr project. Therefore, after determining the energy generation and the costs for this renewable energy project, it can be determined that using standard assumptions it would not be economically feasible to invest in the Eco-Powr project strictly from a financial perspective.

Now that the energy generation and cost-benefit analysis under the standard assumptions are complete, it is important to discuss some of these implications and expand the potential possibilities through scenario analysis. Although the standard assumptions yield a negative financial outcome, it should be put in perspective that the amount invested in these machines is small in magnitude compared to other projects on BC's campus. Even though the project would result in a net loss from a financial perspective, the magnitude of this loss is very small compared to the college's total net income. In addition, this economic loss should instead be considered a valuable investment opportunity to make BC a more sustainable campus, and work towards long-term financial benefits through energy savings from no longer requiring the treadmills in the Hut to be plugged in. This project would not put BC in significant financial distress if it were to

The fourth scenario focuses on the user energy generation for the machines. Theoretically, over the academic year it would be hopeful that students would get in better shape from continuous exercise. Therefore, their speed and corresponding energy generation would increase as well. This scenario will assume that the energy generation output would increase by 20% for each of the three machines. The energy generation for the treadmill, indoor cycle and elliptical would now be 235 kWh, 157 kWh and 164 kWh respectively. This

combined cycle previously discussed. Therefore, under the best-case scenario assumptions for this project, the LCOE can drop to a financially comparable level where there is no income difference

After determining the amount of energy produced by the machines, the next step is to determine the cost of electricity for the area. According to the US Energy Information Administration (EIA), the average retail electricity price in Massachusetts in 2019 was 18.40 ¢/kWh or 0.184 $/kWh (*State Electricity Profiles*, 2020). Using this as the baseline price of electricity, data from the EIA will then be used to estimate the change in the price of electricity in the coming years. In the past 20 years, there has been about a 2.31% inflation rate on the price of electricity (Sonnichsen, 2020). While electricity prices can fluctuate quite a bit from year to year given certain economic events, this average rate of change will be utilized to create a more accurate estimate of the price of electricity over time. The price of electricity will be estimated over a 30-year time span to better estimate the cost savings each year by taking into account the potential change in electricity cost over time. This will yield a chart, Exhibit 15, which tracks the estimated cost of electricity from 2021 to 2051.

With this chart produced, the previous two steps will be utilized in a final step in order to determine the approximate time it will take to pay back the machine in full and to pay back the difference between an energy-producing machine and a standard machine. Since this analysis is being conducted for three machines and two scenarios, each result will be tallied in a separate exhibit. The energy produced in each scenario is highlighted in Exhibits 4 and 8. The estimated electricity saved each year will be multiplied by each estimate of the cost of electricity which will be tracked in six separate exhibits (Exhibits 16-21) that gives two values: the year's savings and a cumulative amount of money saved by the device over said time period. These results will be compared with that device's cost and the difference in cost between the energy-saving device and the standard equipment as shown in Exhibit 5 to determine the amount of time needed to pay back the device according to both criteria. This also must be done for all three energy-producing machines in both scenarios, creating a total of six payback scenarios to be shared in Exhibit 22 below:

consideration, it should also be noted that these renewable, self-generating machines will continue to become less and less expensive, especially as additional products become available from more brands other than Eco-Powr.

A second caveat worth mentioning also relates to the financial barrier to installing equipment like Eco-Powr machines. Again, while we have established that they are overall significantly more expensive compared to current equipment used at The Hut, it is important to view this financial gap as an investment rather than a significant expense. By purchasing machines that students can power themselves and feed energy back into the building, BC would be investing in their university as an innovative institution, investing in the future of their students and how they utilize recreational facilities, and investing in unique and exciting sustainability opportunities. In addition, the actual cost differential between the self-powering machines and the current equipment is not very significant in the big picture at an institution like BC. Plus, as demonstrated, these machines will reasonably quickly pay off the difference between what the Eco-Powr products cost versus the standard machines that will inevitably need to be re-purchased in the coming years, while being able to contribute electricity back into the building.

In addition, there are several other important benefits to installing these machines and committing to a more sustainable recreation center that surpass the demonstrated cost considerations. First, there is a sustainability argument to be made. While the short-term costs are more expensive than current alternatives, this is an investment opportunity with long-term energy savings. By removing the need to plug-in treadmills and instead replace them with equipment that feeds energy back into the building, energy consumption will decrease as renewable production increases. Furthermore, this provides an interactive, uniquely engaging source of renewable energy that is produced by the students and for the students. Second, there is a student health argument to be made. Based on successful case studies of other university gyms implementing similar energy-producing machines, more students are more likely to visit recreational facilities and use these machines to workout. By having more students maintain active lifestyles and exercise more often than they would otherwise, the Eco-Powr products have

order for this study to be as accurate as possible, we strongly recommend that management at The Hut starts tracking more specific use of the equipment. For example, while the most specific data we were able to access was a log of student sign-ins across fifteen-minute time periods, we

sums to the lights be

VI. References

About Quonset Hut. (n.d.). Boston College Campus Recreation. https://www.bc.edu/bc-web/offices/rec/about/facilities/quonset-hut.html

Anthony, N. (n.d.). *Could Universities Lead the Way to a Self-Powered Gym?* Smart Cities Dive. https://www.smartcitiesdive.com/ex/sustainablecitiescollective/could-universities-lead-way-self-powered-gym/26301/

Barnard, J. (2009, May 17). *Universities generate electricity in the gym*. NBC News. https://www.nbcnews.com/id/wbna30793422

Bidwai, S., Jaykar, A., Shinde, S., & Shinde, S. (2017). Gym Power Station: Turning Workout into Electricity. *International Research Journal of Engineering and Technology*, *4*(3).

Brennan, P. (2012, February 12). UCI Exercise Equipment Generates "Green" Energy. *Orange County Register*.

Chalermthai, B., Sada, N., Sarfraz, O., & Radi, B. (2015, June). *Recovery of Useful Energy From Lost Human Power in Gymnasium*. International Conference on Environment and Electrical Engineering, Rome, Italy.

"Find Products: Ventilation Fans." Energy Star. https://www.energystar.gov/products/heating_cooling/fans_ventilating

Gribble, Steve. "Cycling Power and Speed." The Computational Cyclist. https://www.gribble.org/cycling/power_v_speed.html

How Electricity is Generated. (2020, November 9). US Energy Information Administration. https://www.eia.gov/energyexplained/electricity/how-electricity-is-generated.php

J.M.K.C. Donev et al. Energy Education - Energy vs power. 2019. https://energyeducation.ca/encyclopedia/-

VIII. Appendices

Exhibit 1: Treadmill power output for various running speeds

Exhibit 3: Elliptical power for various treadmill power effort percentages

Elliptical Power Output

Treadmill power:	196
50%	98
60%	118
70%	

Exhibit 4: Standard energy assumptions

Quonset Hut Energy Statistics

Operational Hours/Week	85.75
Operational Days/Academic Year	230
Total Operational Hours/Academic Year	2,818
Entrants/Day	94
Average Students in Hut	7.67
Average Workout	

Exhibit 5: Price differences between Eco-Powr and Life Fitness cardio equipment

Exhibit 6: LCOE values for 5 years under standard assumptions

Cost-Benefit Analysis															
Total Cardio Machine Price Difference	4,888														
Estimated Useful Life of New Equipment (Years)	5	**													
Total Project LCOE ($/kWh)	0.468														
Year		Year 1													
Month	0	1	2	3	4	5	6	7	8	9	10	11	12	Total	
Total Price Difference (monthly)	978	65	65	65	65	65	65	65	65	65	65	65	65	1,760	
Discounted Price	978	65	64	64	63	63	62	61	61	60	60	59	59	1,719	
LCOE ($/kWh)	7.016	0.464	0.460	0.456	0.452	0.449	0.445	0.441	0.438	0.434	0.431	0.427	0.423	0.949	
Year		Year 2													
Month		13	14	15	16	18 319.21 Tm(15)]TETBT*379.31 Tm[18 319.2ETBT1 0 0 1 792.55 379.31 Tm[18 319.2ETBT1 0 0 1 2.25 33379.31 Tm[18 319.2										

Exhibit 7: 2020 Lazard's LCOE values

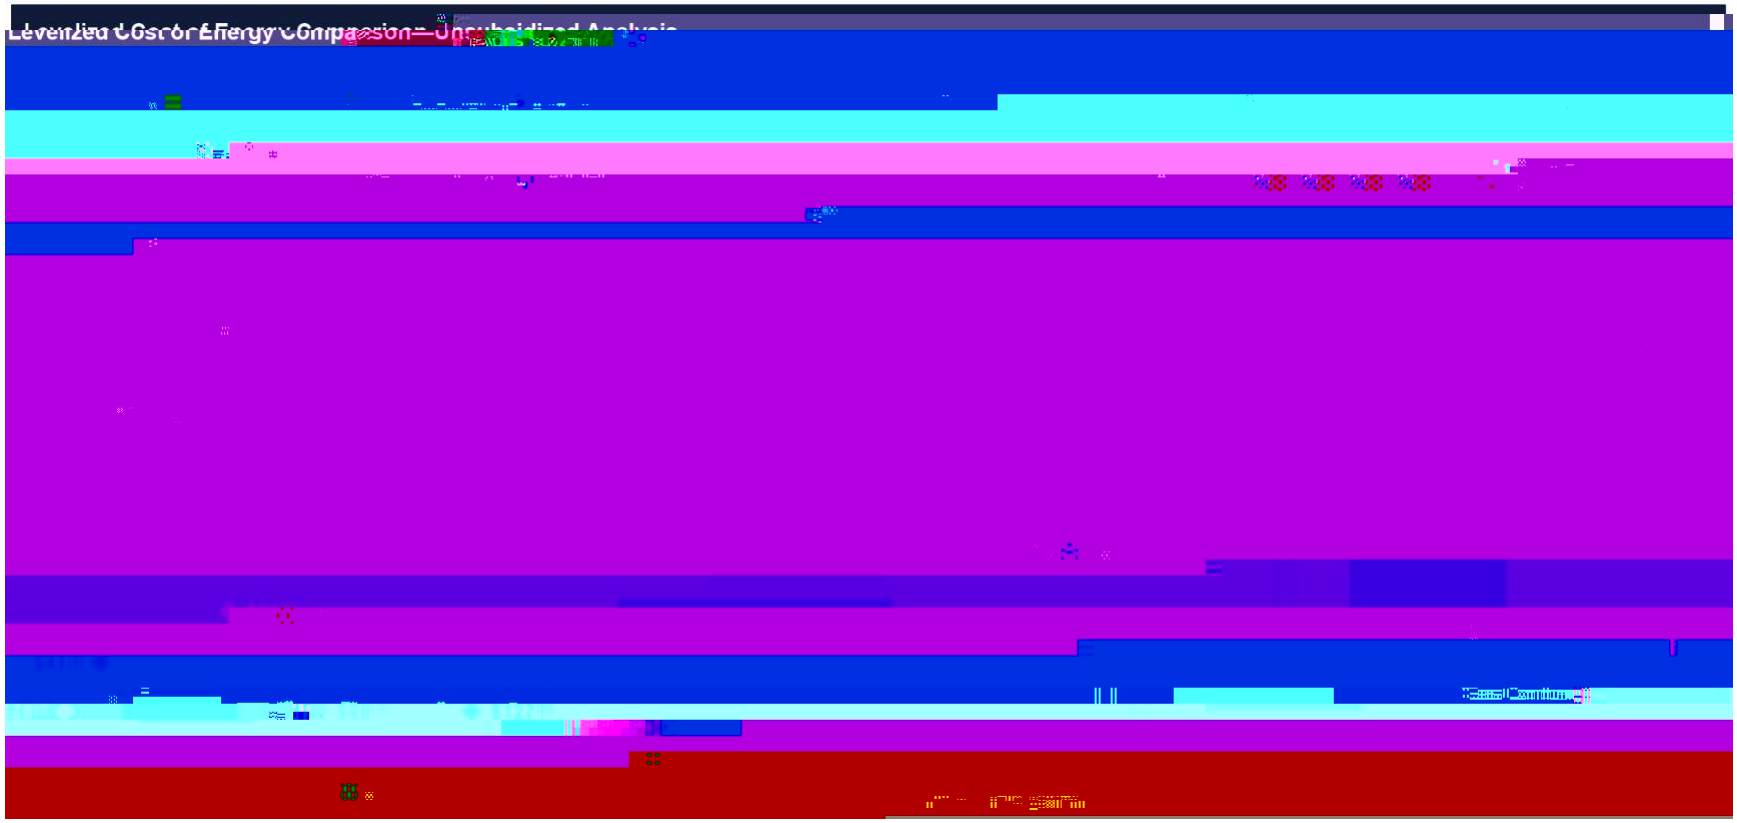

Exhibit 8: Scenario 1 energy generation and cost-benefit analysis

Average Percent Time Spent on Cardio Equipment	70%

Exhibit 11: Scenario 4 energy generation and cost-benefit analysis

Entrants/Day	120
Average Students in Hut	9.80
Average Workout Duration (hours)	1
Average Percent Time Spent on Cardio Equipment	70%
Average Cardio Workout (hours)	0.7
Average Students in Hut doing Cardio Exercise	6.86
Number of Treadmills	3
Number of Indoor Cycles	3
Number of Ellipticals	1
Cardio Equipment Utilization Factor	

Exhibit 12: Scenario 5 energy generation and cost-benefit analysis

Entrants/Day	120
Average Students in Hut	9.80
Average Workout Duration (hours)	1

Exhibit 13: Scenario 6 cost-benefit analysis

Cost-Benefit Analysis															
Total Cardio Machine Price Difference	2,293														
Estimated Useful Life of New Equipment (Years)	10 **														
Total Project LCOE ($/kWh)	0.044														
Year		Year 1													
Month	0	1	2	3	4	5	6	7	8	9	10	11	12	Total	
Total Price Difference (monthly)	459	15	15	15	15	15	15	15	15	15	15	15	15		642
Discounted Price	459	15	15	15	15	15	15	14	14	14	14	14	14		632
LCOE ($/kWh)	1.535	0.051	0.050	0.050	0.049	0.049	0.049	0.048	0.048	0.047	0.047	0.047	0.046		0.163
Year		Year 2													
Month		13	14	15	16	17	18	19	20	21	22	23	24	Total	
Total Price Difference (monthly)		15	15	15	15	15	15	15	15	15	15	15	15		183
Discounted Price		14	14	13	13	13	13	13	13	13	13	13	13		157
LCOE ($/kWh)		0.0459	0.0455	0.0452	0.0448	0.0444	0.0441	0.0437	0.0433	0.0430	0.0426	0.0423	0.0419		0.0439
Year		Year 3													
Month		25	26	27	28	29	30	31	32	33	34	35	36	Total	
Total Price Difference (monthly)		15	15	15	15	15	15	15	15	15	15	15	15		183
Discounted Price		12	12	12	12	12	12	12	12	12	12	11	11		142
LCOE ($/kWh)		0.0416	0.0412	0.0409	0.0406	0.0402	0.0399	0.0396	0.0392	0.0389	0.0386	0.0383			

Exhibit 13 cont.

Year	Year 6											
Month	61	62	63	64	65	66	67	68	69	70	71	72 Total

Exhibit 14: Summary LCOE values for the scenarios

Summary of Scenarios

Standard Assumption	0.468
Scenario 1: 70% average time spent on cardio equipment	0.334
Scenario 2: One less machine for each type of cardio exercise	0.243
Scenario 3: 120 entrants/day in the Hut	0.190
Scenario 4: 20% increase in Energy Generation for each cardio machine	0.158
Scenario 5: 5 ellipticals, 1 treadmill and 1 indoor cycle	0.102
Scenario 6: 10 year financing	0.044

Exhibit 15: Estimated Cost of Electricity 2021-2050

Exhibit 16: Electricity Cost Savings Over Time; Indoor Cycle, Standard Scenario

Year	In X Year ($)	Cumulative total ($)
2021	86.854808	86.854808
2022	88.86115406	175.7159621
2023	90.91384672	266.6298088
2024	93.01395658	359.6437654
2025	95.16257898	454.8063444
2026	97.36083455	552.1671789
2027	99.60986983	651.7770487
2028	101.9108578	753.6879066
2029	104.2649986	857.9529052
2030	106.6735201	964.6264253
2031	109.1376784	1073.764104
2032	111.6587588	

Exhibit 17: Electricity Cost Savings Over Time; Indoor Cycle, Scenario 1

Year	In X Year ($)	Cumulative total ($)
2021	121.596584	121.596584
2022	124.4054651	246.0020491
2023	127.2792313	373.2812804
2024	130.2193816	503.500662
2025	133.2274493	636.7281113
2026	136.3050034	773.0331147
[redacted]	139.4536489	912.4867636

Exhibit 19: Electricity Cost Savings Over Time; Treadmill, Scenario 1

Year	In X Year ($)	Cumulative total ($)
2021	181.93092	181.93092
2022	186.1335243	368.0644443
2023	190.4332087	558.4976529
2024	194.8322158	753.3298687
2025	199.33284	952.6627087
2026	203.9374286	1156.600137
2027	208.6483832	1365.24852
2028	213.4681608	1578.716681
2029	218.3992753	1797.115957
2030		

Exhibit 20: Electricity Cost Savings Over Time; Elliptical, Standard Scenario

Year	In X Year ($)	Cumulative total ($)

Exhibit 21: Electricity Cost Savings Over Time; Elliptical, Scenario 1

Year	In X Year ($)	Cumulative total ($)
2021	127.165896	127.165896
2022	130.1034282	257.2693242
2023	133.1088174	390.3781416
2024	136.1836311	526.5617727
2025	139.3294729	665.8912456
2026	142.5479838	808.4392294
2027	145.8408422	954.2800716

Exhibit 22: Payback Periods for Each Machine and Scenario

	Standard	3-4	17-18
Indoor Cycle	1	2-3	12-13